

NOTES:


ALL WORK DONE PER NFPA 13 2010 EDITION

ALL WORK DONE PER CITY OF KIRKLAND REQUIREMENTS

MAX SPACING IS 225' PER NFPA 13 LIGHT HAZARD


NEW PIPING SHALL BE 1" BLACK SCH. 40

SCOPE: ADD (3) THREE NEW PENDENT SPRINKLERS FOR COVERAGE DUE TO ADDED DEMISING WALL.

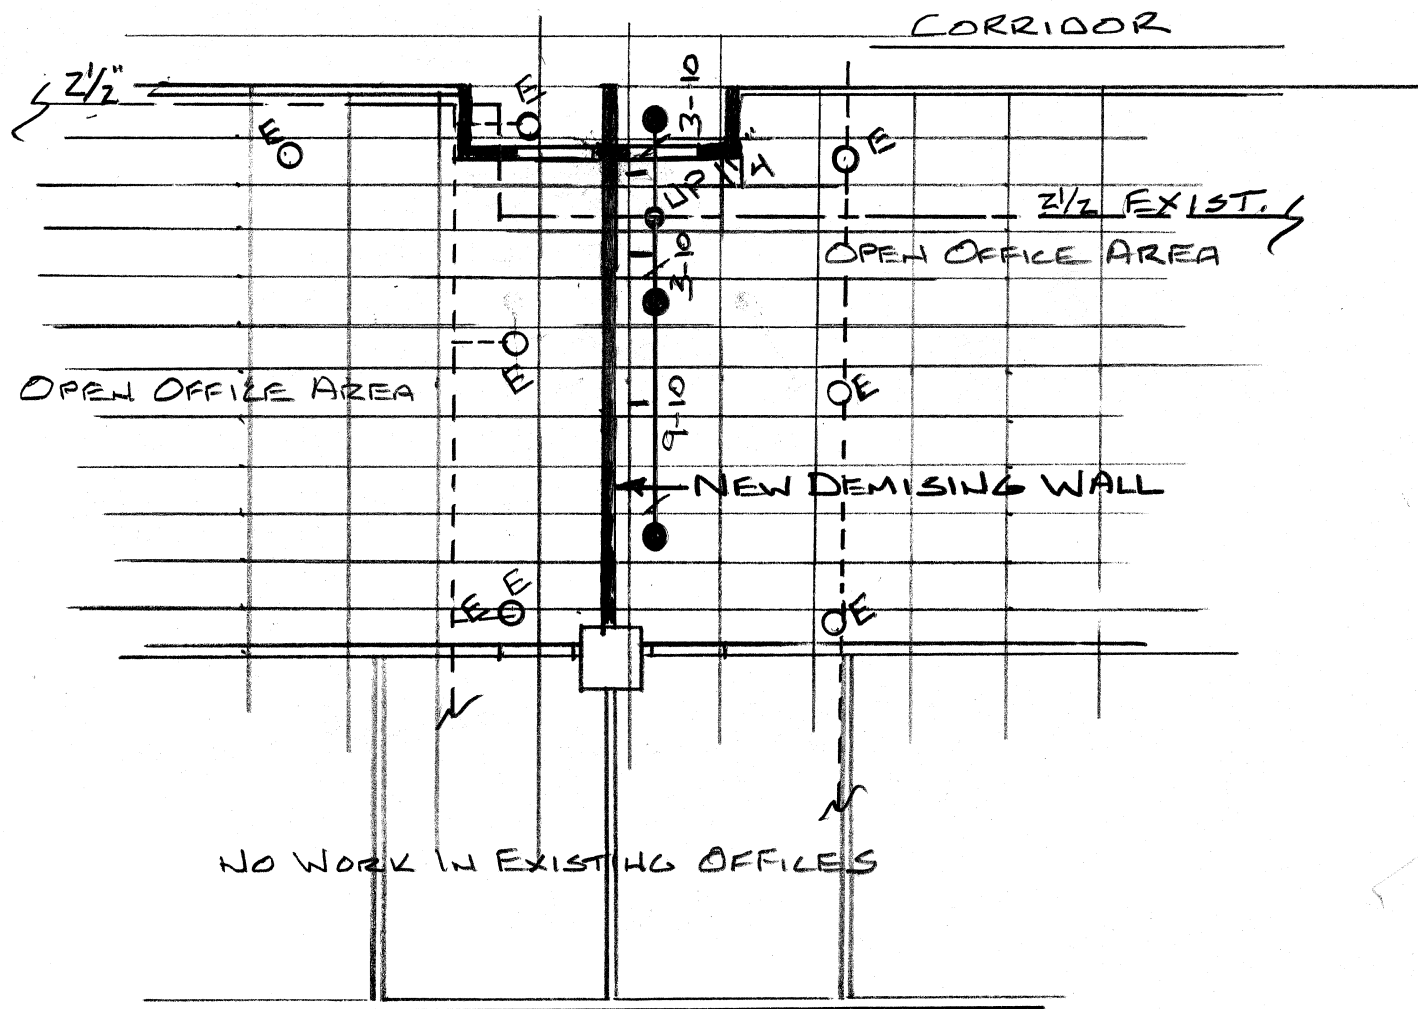


NEW FIRE SPRINKLER LOCATION PLAN

1/8" = 1'-0"




○ EXISTING PENDENT LOCATION

● NEW PENDENT LOCATION

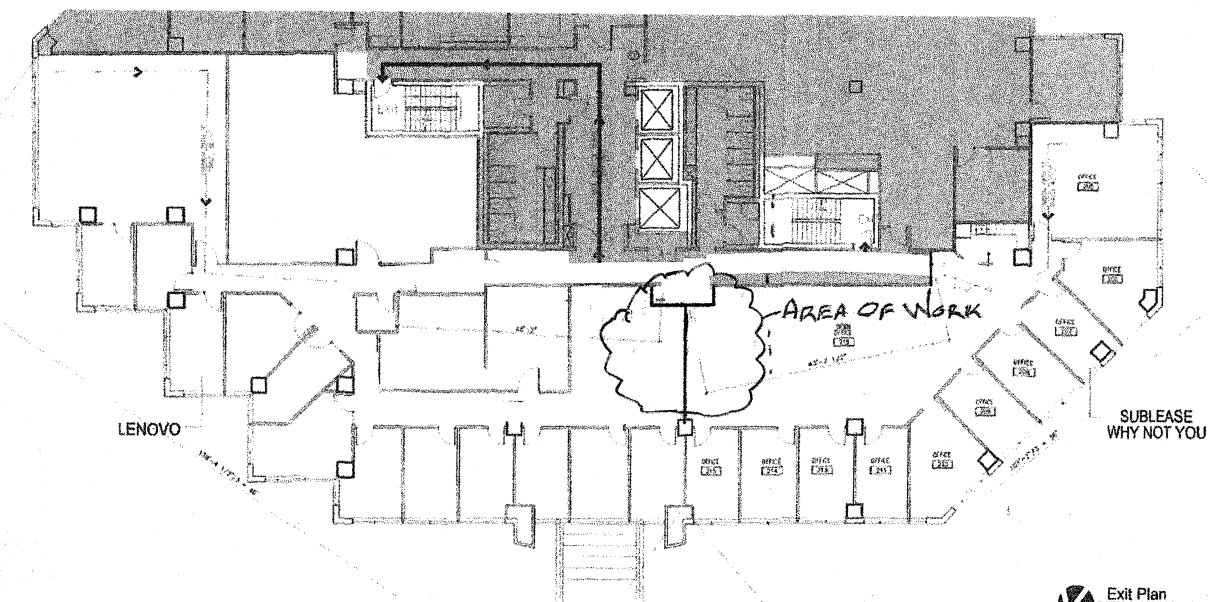

BUILDING REFERENCE PLAN

NO SCALE

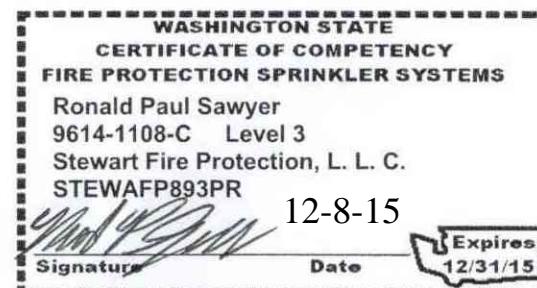

STEWART FIRE PROTECTION, LLC

1935 LUDWIG RD. SNOHOMISH WA 98290 360.568-4935

PROJECT: WHY NOT YOU FOUNDATION T.I.

CARILON BLDG. 3000 FLOOR 2

3200 CARILON POINT KIRKLAND WA 98033

SCOPE: RELOCATE 2 SPRINKLERS FOR NEW WALL

RELATED BLDG. PERMIT #

12-Z-15